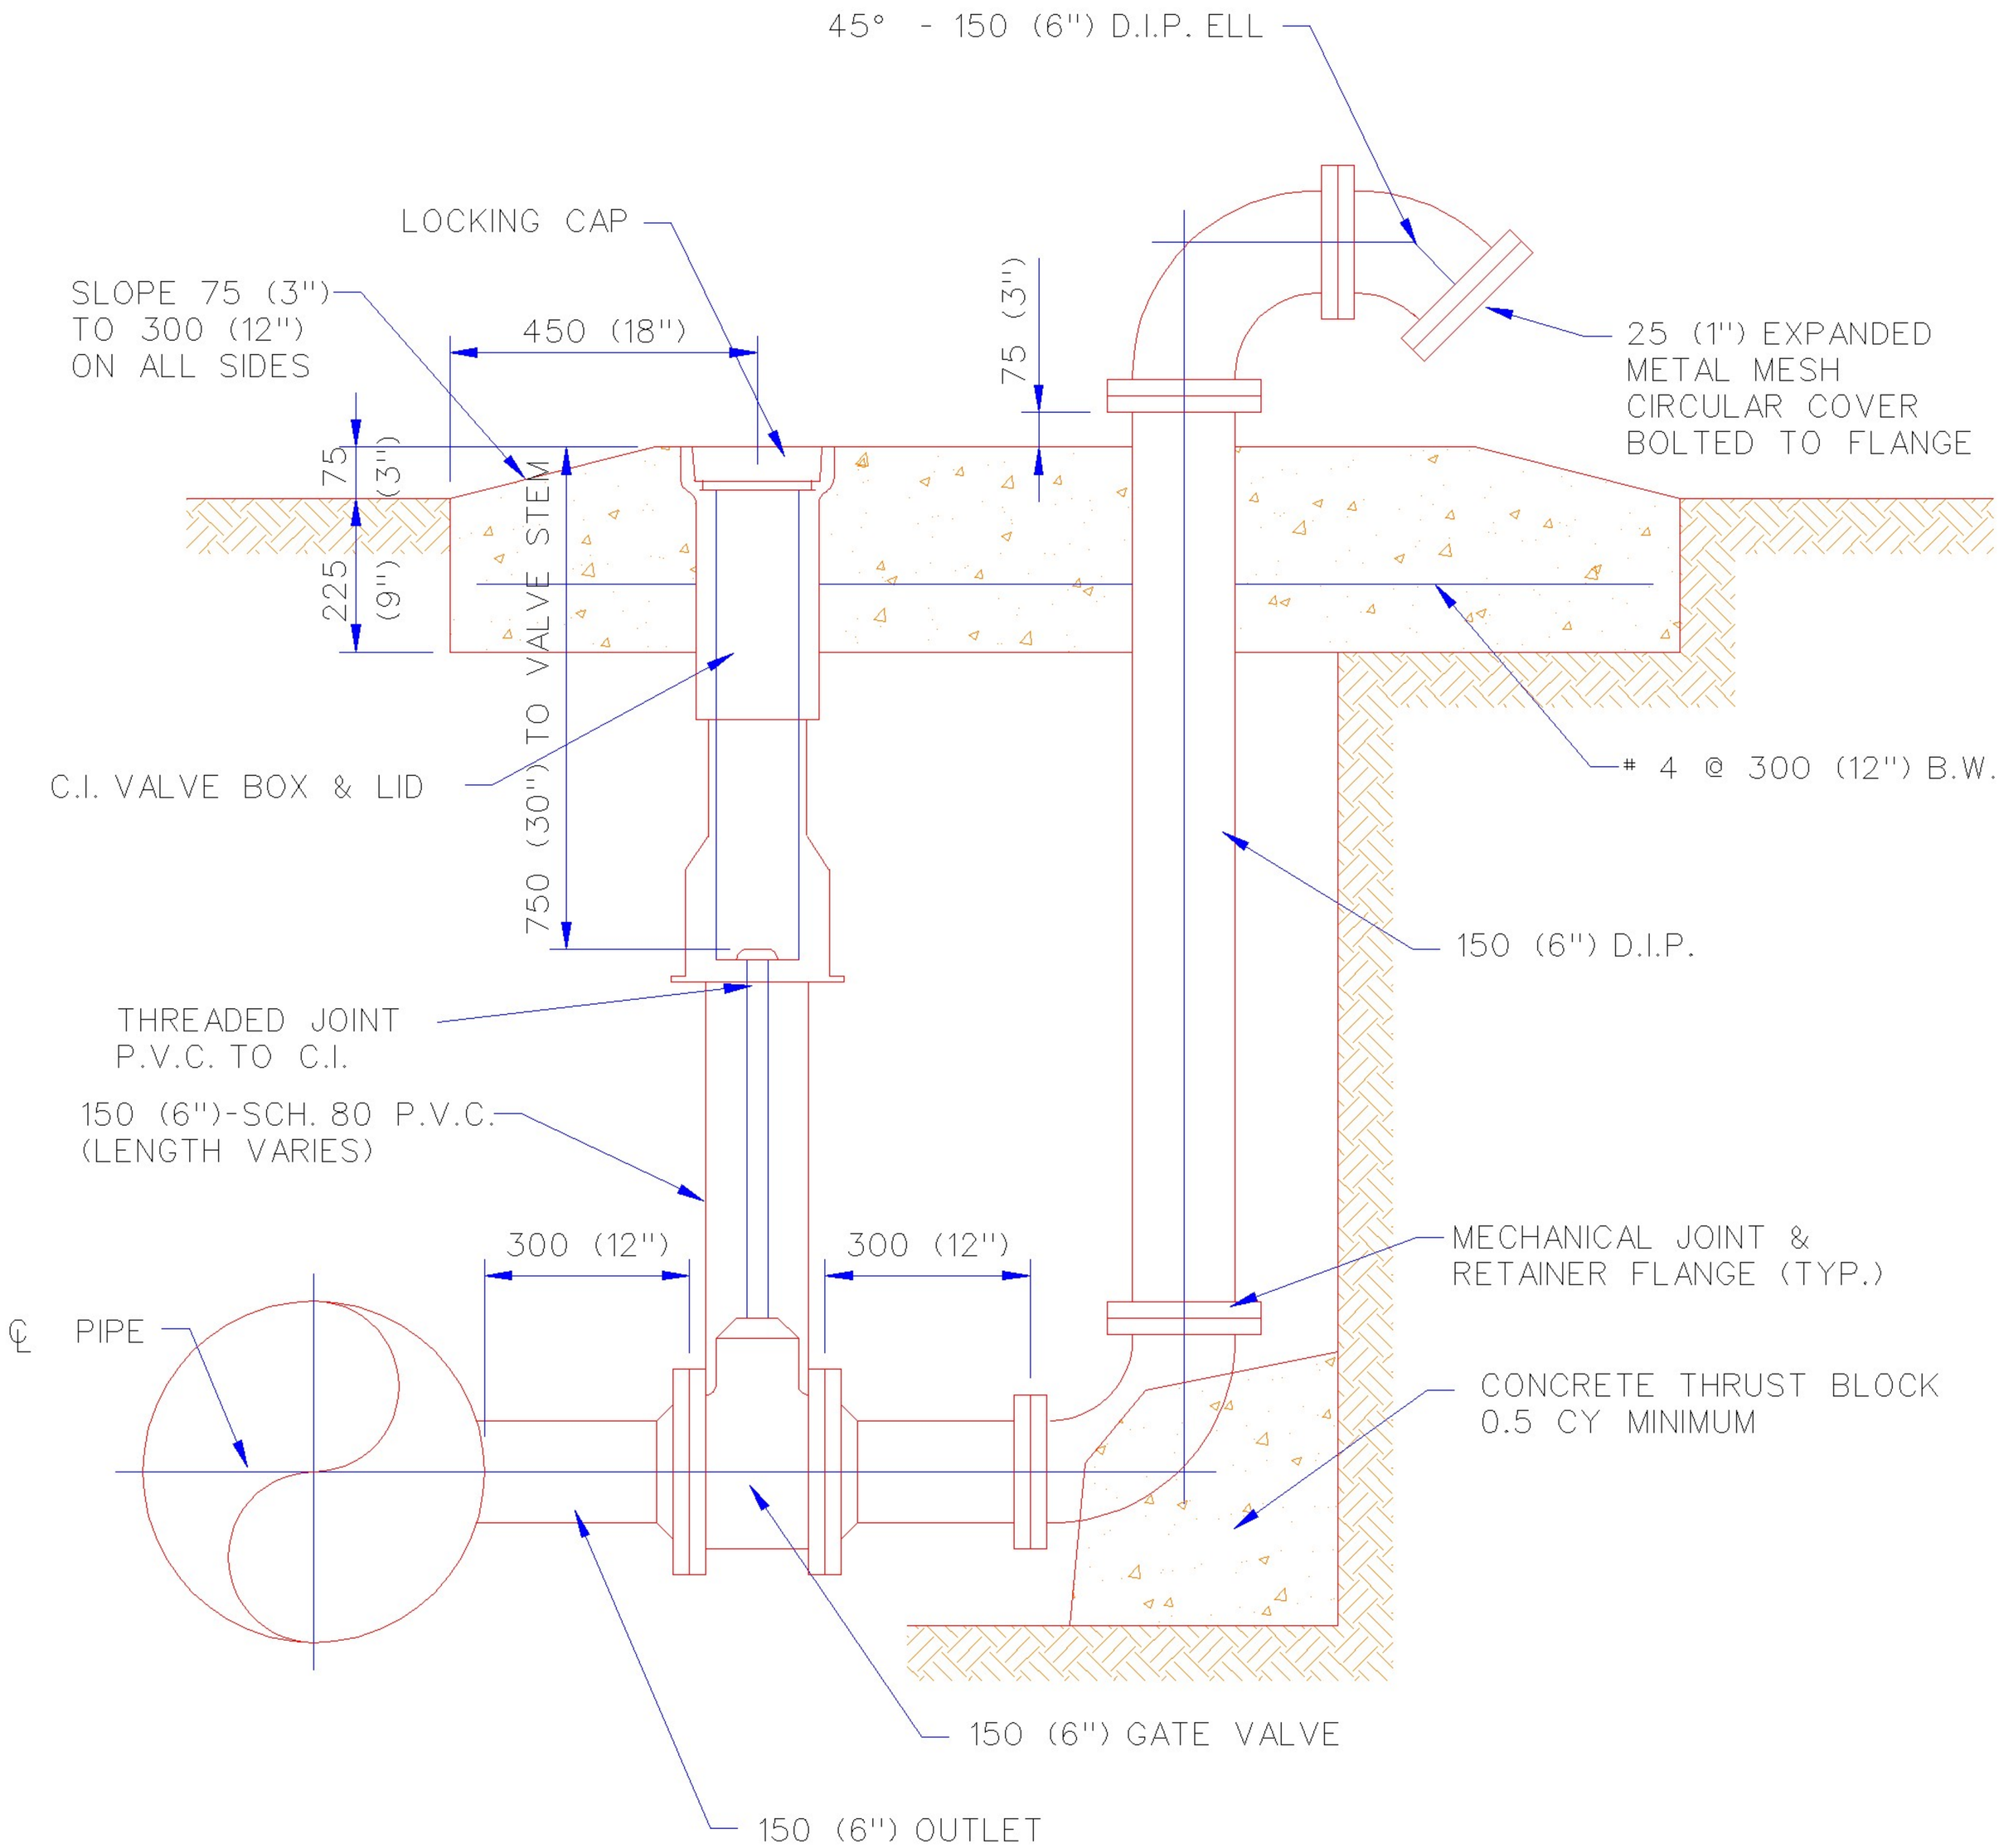

NOTES:

1. ALL EXPOSED METAL TO RECEIVE 2 COATS OF ALUMINUM INDUSTRIAL GRADE PAINT.
2. CONCRETE PAD TO BE 800 MM X 1800 MM X 300 MM (2'-8" X 6'-0" X 1'-0")

METRIC UNITS ARE IN MM WITH ENGLISH UNITS IN PARENTHESIS, UNLESS INDICATED OTHERWISE.

BLOW OFF VALVE ASSEMBLY

City Engineer Approval:		CITY OF NORMAN, OKLAHOMA	
Approval Date:	Revision Date:	Rev. No. 0	DRAWING NO. W 12